



FIG. 1

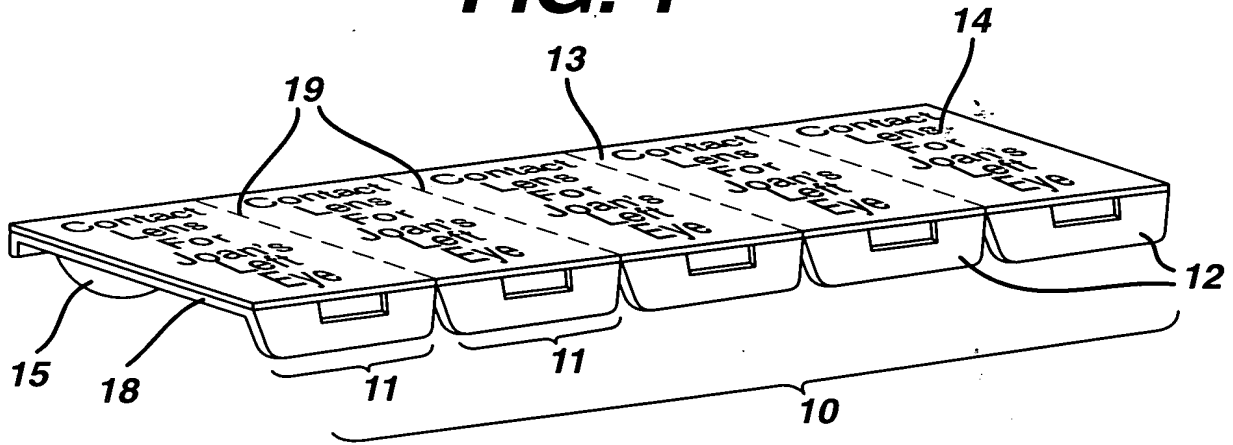


FIG. 2

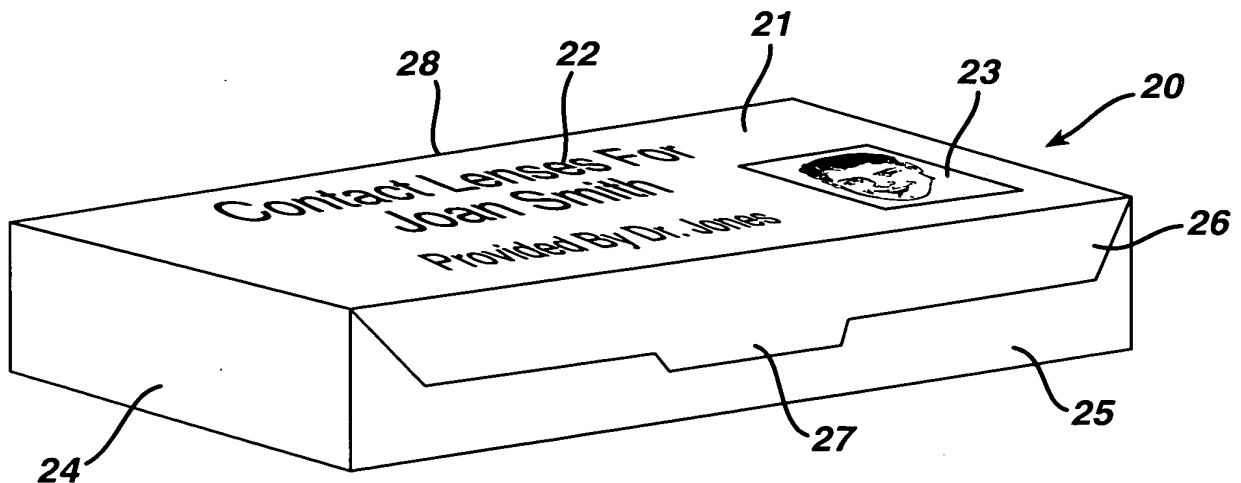




FIG. 3


30

31

These contact lenses are provided to Joan Smith by
DR. JONES, O.D.
Our office will call you in one month to schedule a follow-up.
In the interim if you have any problems with these
contact lenses, please call my office at 555-5555.

Your eyes are important to me.

FIG. 4

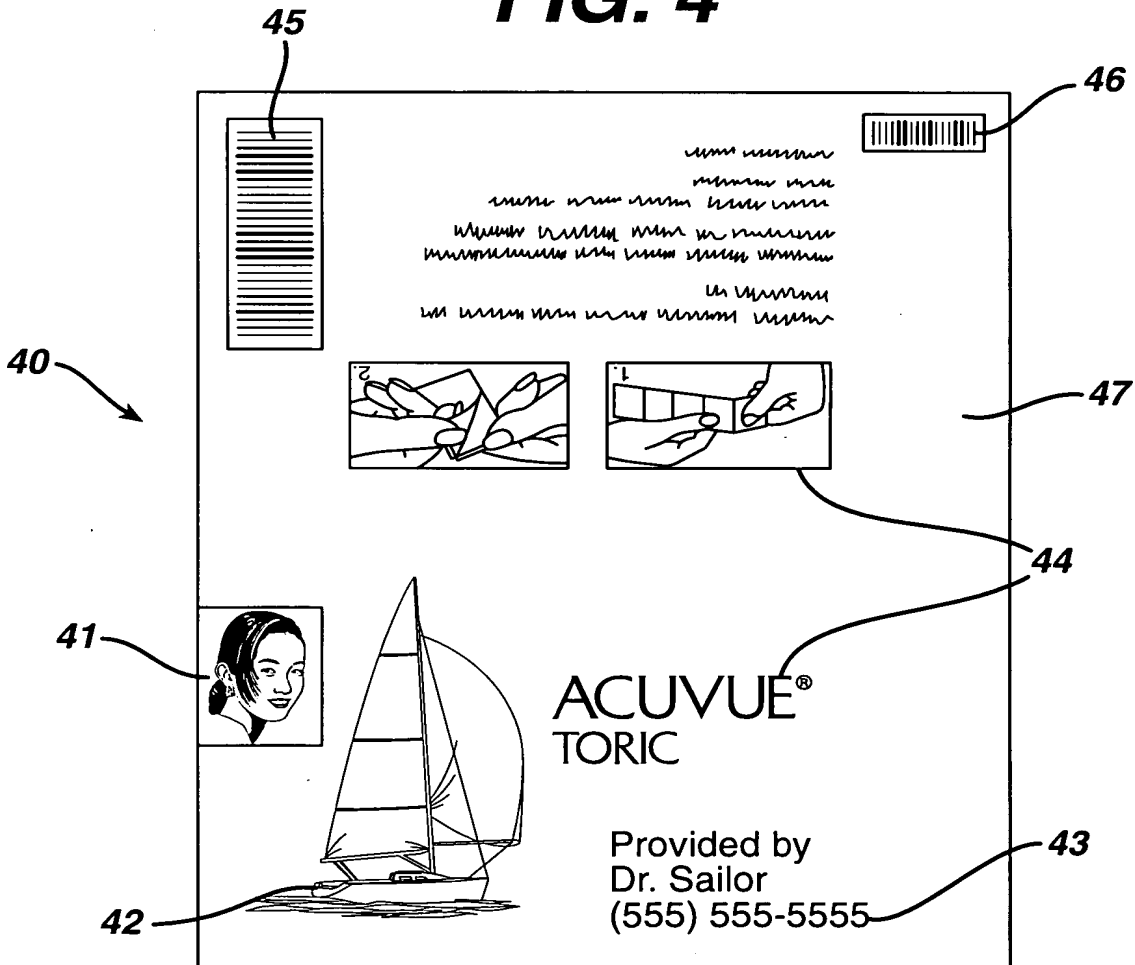



The diagram illustrates a system 500 for processing a substrate 514. The system includes a main processing unit 502, which is connected to a control unit 501 via a bus 520 and a signal line 512. A power supply unit 503 provides power to the system. The substrate 514 is positioned below the main unit, with a sensor 551 and a heater 513. A series of rollers 517 are used to transport the substrate. The main unit 502 has input/output ports 550 and 551, and internal components 504, 505, and 506.

FIG. 6

61	62	63	64	65	66	67	68	69	70
Order No.	SKU	Graphics	Graphics	Label Identification	Spool No.	Row	Column	Reject	Reel
10175	CL00525	B0781	M048	25433	2	1	1		7
10175	CL01073	B0781	M048	25434	2	2	1		7
10175	CL01073	B0781	M048	25435	2	3	1		7
11139	CL01073	B0781	M175	25436	2	4	1		7
11139	CL00091	B0489	M175	25437	2	5	1		7

60

